KYN28-12 Series Armored Movable AC Metal-Enclosed Switchgear

1 Overview




KYN28-12 indoor AC armored removable metal-enclosed switchgear is used in three-phase AC power system with rated voltage of 12kV and rated frequency of 50Hz for receiving and distributing electric energy and for control protection and monitoring of circuits.

This series of products have "Five-Prevents" interlock functions of preventing the push-pull of circuit breaker handcart under load, preventing false ON &OFF of circuit breaker, preventing power-on/ off of circuit breaker when the Earthing switch is in the closed position, preventing entering the live compartment, and preventing turning on the Earthing switch when electrified. This product is a power distribution that can be equipped with the ZN63A-12 vacuum circuit breaker developed by our company and the VD4, VB2 and 3AH vacuum circuit breakers from various manufacturers for superior performance.

This product complies with GB3906 "3~35kV Alternating-current metal-enclosed switchgear", GB/T 11022 "Common specifications for high-voltage switchgear and controlgear standard", and DL/T404 "Technical conditions for ordering indoor AC high-voltage switchgear".

2 Type Designation

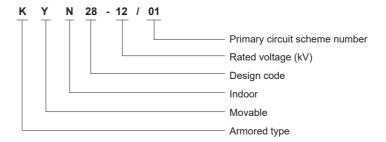

3 Technical Parameters

3.1 Technical parameters of switchgear equipment

Name	Unit	Parameter
Rated voltage	kV	12
Rated power frequency withstand voltage 1min Ud	kV	Phase-to-phase, to earth 42, open contacts 48
Rated impulse withstand voltage, Up(peak)	kV	Phase-to-phase, to earth 75, open contacts 85
Rated freq.	Hz	50
Rated current	Α	630, 1250, 1600, 2000, 2500, 3150, 4000
Rated current of branch busbar	Α	630, 1250, 1600, 2000, 2500, 3150, 4000
Rated short-time withstand current(effective value)	kA	20, 25, 31.5, 40
Rated peak withstand current	kA	50, 63, 80, 100
Rated short-circuit duration	S	4
Protection grade		Housing: IP4X; when the compartment door and circuit breaker door are open: IP2X

KYN28-12 Series Armored Movable AC Metal-Enclosed Switchgear

3.2 Technical parameters of KYN28-12 vacuum circuit breaker

Name	Unit		Parar	neter	
Rated voltage	kV	12			
Rated lighting impulse withstand voltage (peak)		open contact	ts 85, ph eart		phase and to
Rated power frequency withstand voltage (1min)		open contact	ts 48, ph eart		phase and to
Rated freq.	Hz		5	0	
Rated short-circuit breaking current	kA	20, 25	31	.5	40
Rated current	Α	630~1,250	630~	4,000	1250~4,000
Rated short-time withstand current	kA	20, 25	20, 25 31.5		40
Rated peak withstand current		50, 63	80		100
Rated short-circuit making current (peak)	kA	50, 63 80 100		100	
Power frequency withstand voltage of secondary circuit (1min)	V	1,000	0 (2,000	custon	nized)
Rated operating sequence		O—0.3s—C 180s—C	-	_	180s—CO— 80s—CO
Rated short-circuit duration	s		4	ļ	
Rated single/back-to-back capacitor bank	^	20~31.5k	Α		40kA
breaking current	Α	630/400 800/400		800/400	
Rated capacitor bank making inrush current		12.2 (With frequency not greater than1000Hz)		ot greater	
Mechanical life	Times	1	10000/customized		
Rated short-circuit current breaking times	Times		30		

4 Operating Conditions

- 4.1 Ambient temperature: Max.: +40°C, Min.: -15°C (down to -45°C under special process conditions);
- 4.2 Ambient humidity: daily mean < 95%, monthly mean ≤ 90%;
- 4.3 Altitude: no more than 1,000 meters;
- 4.4 Earthquake resistance: the earthquake intensity does not exceed magnitude 8;
- 4.5 There is no obvious pollution such as corrosion or flammable gas, and water vapor in the surrounding air;
- 4.6 There is no serious dirt and frequent violent vibration; the Category 1 shall be met under severe conditions:

Note: If deviation of normal service conditions occurs, the customer should inform the manufacturer before production.

//ledium Voltage Apparatus


KYN28-12 Series Armored Movable AC Metal-Enclosed Switchgear

5 Features

- 5.1 With a perfect and complete switchgear scheme and with mature structure, various power supply system schemes can be flexibly formed according to the needs of different users to fully satisfy the field and operation requirements.
- 5.2 Complete "Five-prevent" interlock provided: the reverse interlock of the rear door, the valve interlock, the interlock of middle door, and the emergency switch-off mechanism can be match as needs for high safety performance.
- 5.3 The 2.0 aluminum-zinc-coated steel plate is made by inward folding and double bending process. The entire frame is riveted with high-strength cup-shaped blind rivets. The riveted cabinet features with high stability; the cabinet door is sprayed with plastics providing strong impact resistance and corrosion resistance.
- 5.4 The standardized product design and modularized, assembled, and systematic design development are adopted for convenient organization of production; the product has high safety and interchangeability and features with easy installation, operation, and maintenance.
- 5.5 The different brand of vacuum circuit breaker can be selected; that is, our brand of circuit breaker can be used, and other brand is also available.


6 Product Structure Design and Dimensions

6.1 Standard high and low cabinets




Height B (mm)		2300
	The related current of the branch busbar is ≤1250, the thermal stability current is ≤31.5kA	650
Width A (mm)	The related current of the branch busbar is ≤1250, the thermal stability current is ≤40kA	800
	The related current of the branch busbar is ≥ 1600	1000
Depth C	Cable outlet	1500
(mm)	Overhead inlet and outlet lines	1660

KYN28-12 Series Armored Movable AC Metal-Enclosed Switchgear

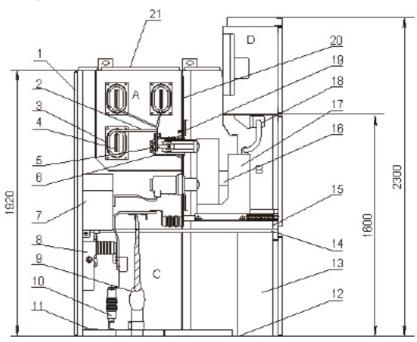


- A. Busbar chamber
- 1. Housing
- 5. Stationary contact device
- 9. Cable
- 13. Control small busbar
- 17. Circuit breaker cart
- 21. Voltage discharge channel
- B. Circuit breaker cart chamber
- 2. Branch small busbar
- 6. Contact box
- 10. Arrester
- 14. Earth switch operating mechanism
- 18. Secondary plug
- C. Cable chamber
- 3. Busbar bushing
- 7. Current transformer
- 11. Earth main busbar
- 15. Withdrawable type horizontal barrel
- 19. Barrel (valve)
- D. Relay instrument chamber
- 4. Main busbar
- 8. Earth switch
- 12. Base plate
- 16. Heating device
- 20. Removable barrel

6.2 Standard flat-top cabinet



Hoight P		2200
Height B (mm)	Rated current:	2300
,	4000~5000A	2300
	Rated current of branch	
	busbar: ≤1250; Thermal	650
	stability current: ≤31.5kA	
Width A	Rated current of branch	
(mm)	busbar: ≤1250; Thermal	800
	stability current: ≤40kA	
	Rated current of branch	1000
	busbar: ≥1600	1000
	Cable outlet and	
Donth C	overhead incoming and	1350
Depth C	outgoing line	
(mm)	Rated current:	1550
	4000~5000A	(1660)

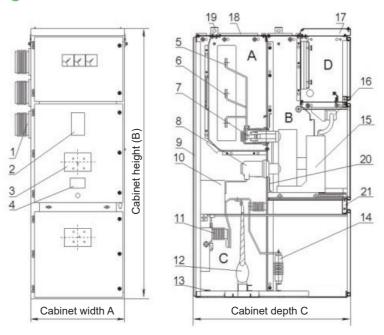

- A. Busbar chamber
- 1. Busbar bushing
- 5. Main busbar
- 9. Rear seal plate
- 13. Main earth busbar
- 17. Secondary small busbar chamber
- 21. Withdrawable type horizontal barrel
- B. Circuit breaker cart chamber
- 2. Analog busbar coil
- 6. Branch busbar
- 10. Current transformer
- 14. Arrester
- 18. Pressure discharge cover
- C. Cable chamber
- 3. Cart chamber observation window
- 7. Stationary contact
- 11. Earth switch
- 15. Circuit breaker cart
- 19. Lifting lug
- D. Relay instrument chamber
- 4. Nameplate
- 8. Contact box
- 12. Cable
- 16. Aviation plug
- 20. Barrel (valve)

7 Primary Main Circuit Schematic Diagram

S	scheme No.	01	02	03	04	05	06
Main	circuit schematic diagram	<u>\$\$</u>	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\			\$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\
(WxD	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200				
	Rated current (A)			630-	5000		
trical	Vacuum circuit breaker (ZN63A)	1	1	1	1	1	1
Main electrical components	Current transformer	2	2	2	3	3	3
Ma	Earthing switch		1	1		1	1
	Lightning arrester			3			3
(Circuit name	Receiving, feed	Receiving, feed	Receiving, feed	Receiving, feed	Receiving, feed	Receiving, feed
	Remarks						

S	cheme No.	07	08	09	10	11	12
Main	circuit schematic diagram	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	\$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$		₩ ₩ ₩ ₩	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\
(WxD:	net dimensions xH)(high and low cabinet) flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200
<u></u>	Rated current (A)			630-	5000		
ectrica	Vacuum circuit breaker (ZN63A)	1	1	1	1	1	1
Main electrical components	Current transformer	2	2	2	3	3	3
≥ °	Earthing switch		1		1		1
C	Circuit name	Contact (right)	Contact (right)	Contact (left)	Contact (left)	Contact (right)	Contact (right)
	Remarks						
S	cheme No.	13	14	15	16	17	18
Main	circuit schematic diagram		\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\		\$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\
(WxD:	net dimensions xH)(high and low cabinet) flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200
_	Rated current (A)			630-	5000		
ectrica	Vacuum circuit breaker (ZN63A)	1	1	1	1	1	1
Main electrical components	Current transformer	3	3	2	2	2	2
≥ 0	Earthing switch	1		1	1		1
C	Circuit name	Contact (left)	Contact (left)	Overhead incoming line (left contact)	Overhead incoming line (left contact)	Overhead incoming line (right contact)	Overhead incoming line (right contact)
	Remarks						

S	cheme No.	19	20	21	22	23	24	
Main	circuit schematic diagram						49 (***)	
(WxD	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200						
=	Rated current (A)	630-5000						
ectrica	Vacuum circuit breaker (ZN63A)	1	1	1	1	1	1	
Main electrical components	Current transformer	3	3	3	3	2	2	
Σ	Earthing switch		1		1		1	
(Circuit name	Overhead incoming line (left contact)	Overhead incoming line (left contact)	Overhead incoming line (right contact)	Overhead incoming line (right contact)	Overhead incoming and outgoing line	Overhead incoming and outgoing line	
	Remarks							

Medium Voltage Apparatus

S	cheme No.	25	26	27	28	29	30
Main	circuit schematic diagram					88 0	818
(WxD	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200					
	Rated current (A)			630-	5000		
	Vacuum circuit breaker (ZN63A)	1	1	1	1	1	1
ctrical	Current transformer	2	3	3	3	2	2
Main electrical components	Voltage transformer					2	2
Σο	High-voltage fuse					3	3
	Earthing switch	1		1	1		1
	Lightning arrester	3			3		
(Circuit name	Overhead incoming and outgoing line	Incoming cable + PT	Incoming cable + PT			
	Remarks						

S	Scheme No.	31	32	33	34	35	36		
Main	circuit schematic diagram		860 000 000 000 000 000 000 000 000 000	88 3	88				
(WxD	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200							
	Rated current (A)	630-5000							
	Vacuum circuit breaker (ZN63A)	1	1	1	1	1	1		
ctrical	Current transformer	2	3	3	3	2	2		
Main electrical components	Voltage transformer	2	2	2	2	3	3		
ž	High-voltage fuse	3	3	3	3	3	3		
	Earthing switch			1			1		
	Lightning arrester	3			3				
(Circuit name	Incoming cable + PT							
	Remarks								

S	cheme No.	37	38	39	40	41	42
Main	circuit schematic diagram		8-8		98	***	10
(WxD:	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1000 1350x2200	650 800 x 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200
	Rated current (A)			630-	5000		
<u></u>	Vacuum circuit breaker (ZN63A)	1					
ectrica	Current transformer	2					
Main electrical components	Voltage transformer	3	2	2	2	3	2
2	High-voltage fuse	3	3	3	3	3	3
	Lighting arrester	3			3	3	3
C	Circuit name	Incoming cable + PT	Voltage measurement	Voltage measurement	Voltage measurement + Lighting arrester	Voltage measurement + Lighting arrester	Voltage measurement + Lighting arrester
	Remarks						
S	cheme No.	43	44	45	46	47	48
Main	circuit schematic diagram	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	888	â 8 8	**************************************	\$\$88 \$\$8	
(WxD:	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200
cal ts	Rated current (A)		T	630-	5000	T	T
Main electrical components	Voltage transformer	3	2	2	3	3	2
/ain com	High-voltage fuse	3	3	3	3	3	3
2	Lighting arrester	3					3
C	Circuit name	Voltage measurement + Lighting arrester	Voltage measurement + Buscouple	Voltage measurement + Buscouple	Voltage measurement + Buscouple	Voltage measurement + Buscouple	Voltage measurement + Lighting arrester + Buscouple
	Remarks						
S	cheme No.	49	50	51	52	53	54
Main	circuit schematic diagram		Î Î	(1) (1) (1) (1) (1) (1) (1) (1) (1) (1)	\$		\$
(WxD:	inet dimensions xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200
, <u>a</u>	Rated current (A)			630-	5000		
Main electrical components	Voltage transformer	2	3	3			
/ain	High-voltage fuse	3	3	3			
2 -	Lighting arrester	3	3	3			
	Circuit name	Voltage measurement + Buscouple	Voltage measurement + Buscouple	Voltage measurement + Buscouple	Buscouple	Buscouple	Buscouple
	Remarks						

5	Scheme No.	55	56	57	58	59	60
Main	circuit schematic diagram		* *	8-8		Y	7.0
(WxD	vinet dimensions 0xH)(high and low cabinet) (flat-top cabinet) (mm)	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200
<u></u>	Rated current (A)	630-5000					
fain electrical	Voltage transformer			2	2		
Main e	High-voltage fuse			3	3		
ğ	Earthing switch						1
	Circuit name	Isolation + Contact (left)	Isolation + Contact (right)	Isolation + Contact (left) + Voltage measurement	Isolation + Contact (right) + Voltage measurement	Outgoing phasing	Isolation outgoing phasing
	Remarks						


S	scheme No.	61	62	63	64	65	66	
Main	circuit schematic diagram	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	**************************************	8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8		**************************************	**************************************	
Cabinet dimensions (WxDxH)(high and low cabinet) Dxh (flat-top cabinet) (mm)		650 800 x 1500x2300 1000 1350x2200						
	Rated current (A)	630-5000						
Main electrical components	Current transformer	2	2	3	3	2	2	
Aain electrica components	Voltage transformer	2	2	2	2	3	3	
_	High-voltage fuse	3	3	3	3	3	3	
Circuit name		Metering + Left contac	Metering + Right contact	Metering + Left contac	Metering + Right contact	Metering + Left contac	Metering + Right contact	
	Remarks				·			

S	scheme No.	67	68	69	70	71	72		
Main circuit schematic diagram		**************************************	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\			\$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$			
Cabinet dimensions (WxDxH)(high and low cabinet) Dxh (flat-top cabinet) (mm)		650 800 x 1500x2300 1000 1350x2200	650 800 x 1500x2300 1000 1350x2200						
Main electrical components	Rated current (A)	630-5000							
	Current transformer			1	1				
	Voltage transformer	2	2	3	3	2	2		
	High-voltage fuse	3	3	3	3	3	3		
Circuit name		Metering + Left contac	Metering + Right contact	Incoming line + Metering	Incoming line + Metering	Incoming line + Metering	Incoming line + Metering		
Remarks									

KYN28-12 Series Armored Movable AC Metal-Enclosed Switchgear

Scheme No.		73	74	75	76	77	78		
Main circuit schematic diagram							(€+⊕) (+E)		
Cabinet dimensions (WxDxH)(high and low cabinet) Dxh (flat-top cabinet) (mm)		650 800 x 1500x2300 1000 1350x2200							
	Rated current (A)	630-5000							
Main electrical components	Vacuum circuit breaker (ZN63A)	1	1						
	Current transformer	3	3	3	3				
	Voltage transformer	2	2	2	2				
	High-voltage fuse	3	3	3	3	3	3		
	Lightning arrester					3	3		
	Transformer					3			
	Capacitor						3		
Circuit name		Incoming line + Metering	Incoming line + Metering	Incoming line + Metering	Incoming line + Metering	Substation	Capacitor cabinet		
	Remarks								

8 Example of A Typical Scheme of Main Circuit

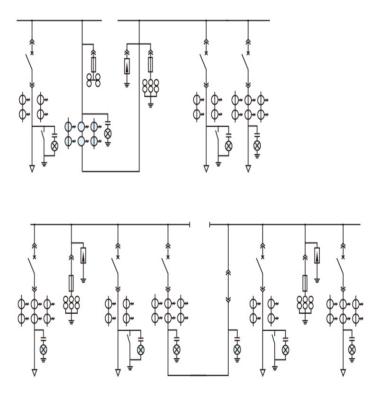

//edium Voltage Apparatus

KYN28-12 Series Armored Movable AC Metal-Enclosed Switchgear

9 Ordering Notice

- 9.1 Main wiring scheme number and single-line system diagram, arrangement diagram and layout plan;
- 9.2 Secondary wiring diagram, terminal arrangement diagram; please refer to the manufacturer's terminal arrangement diagram if there is no terminal arrangement provided;
- 9.3 Model, specification, and quantity of electrical components of switchgear;
- 9.4 Electrical equipment summary list;
- 9.5 The span and height dimensions shall be provided when a busbar bridge (busbar bridge across two columns of cabinets and busbar bridge across wall cabinets) is required;
- 9.6 When the switchgear works in special environmental conditions, this shall be specified when ordering;
- 9.7 Type and quantity shall be given when other equipment is required or the equipment is out of the accessory supply scope;
- $9.8 \ \mbox{Customized}$ through the negotiation with our company for any special requirements.